

AGC OF AN INTERCONNECTED TWO UNEQUAL AREA PROVIDED WITH NON REHEAT THERMAL SYSTEM

¹VINAY KUMAR NAGLE, ²Prof. INDRAJEET KUMAR, ³Prof. BALRAM YADAV
¹ME Scholar, ²Assistant Professor, ³Head of Department
Scope College of Engineering Bhopal

Abstract: - This paper presents AGC of an interconnected two inconsistent region gave Non warm framework. A lady endeavor is made to apply Fuzzy-PID Controller in AGC. Regulator gain is two inconsistent region frameworks are upgraded utilizing a later and strong transformative computational procedure called PSO method. As per this examination correlation that fundamental (I), relative (P), Proportional-necessary subordinate (PID) all gave pretty much reaction though Fuzzy-PID Controller gives much better reaction. In this work Fuzzy-Tuned Controller is investigated as the control structure in two regions interconnected P.S. furthermore study is reached out for the transient reaction of the proposed framework. In this paper all the noticeable regulator and their reaction have been considered and tuned Fuzzy-PID regulator with PSO method gave better dependability and dynamic reaction for the framework looked at other existing regulator. The framework execution is inspected considering 1% advance burden irritations in area1.

Index Terms: - Automatic Generation Control, Step Load Perturbation, Fuzzy-Tuned Controller, Particle Swarm Optimization, Characteristics.

1. INTRODUCTION

In AGC, two region control framework is interconnected of force framework which are interconnected through a tie-line. At the point when two power frameworks are interconnected one framework is to have the option to exchange the power with adjoining framework with adjoining framework whose working costs make such product beneficial. On the off chance that one framework experience an unexpected loss of an age, the unit all through all the interconnection will encounter a recurrence change and can help in reestablishing recurrence [1-2].

In utility system, electrical generator converts mechanical power into electrical power and steam turbine that drive the generator convert fuel energy into electrical energy. AGC has three major objectives;

1. To screw the system frequency at or close to a specified nominal value.
2. To balance each unit's generation at the most economic value.
3. To balance the interchange of power between the control areas.

Crafted by the control regions controls the heap and age of an interconnected power framework. Basically two kinds of control circles are accessible in AGC, for example, (1)

essential control (load recurrence control), (2) auxiliary control (Automatic voltage controller). AGC is quite possibly the main assistant service to be kept up with for limiting recurrence divisions, keep up with of age and burden request [3]. Load recurrence control issue in power framework activity and control has a long history [5]. The heap recurrence control is the perhaps the main job in current energy the board system [6]. The utility frameworks have non-straight and time fluctuating nature [7-9].

From the investigations have been carried out to design an optimal automatic generation controller to enhance the stability and preserve the security of the system [10]. Dynamic performance of all conventional classical controllers

[4] like Integral, P, PI, PID controllers and soft controller (Fuzzy-Tuned Controller) [13]. A more recent and powerful evolutionary computational technique Particle Swarm Optimization (PSO) is used here for simultaneous optimization of several parameters for both primary and secondary control loops of the governor with different types of classical controller and soft controllers. This classical controller and soft controller are tried and their performance compared so as to assess the best controller. Sensitivity analysis has been carried out too for the best controller.

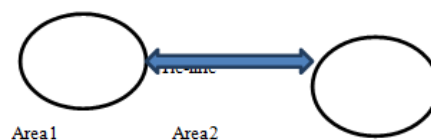


Fig.1. two area interconnected system.

System Investigation

Investigation has been carried out on two unequal area system area1 = 2000MW; area2 = 4000MW provided with non-reheat Turbine in both control areas. Integral, Proportional, PI, PID and Fuzzy PID controller are considered for investigation [15] and shown in appendix. A parameter a12 = -1 is considered in two area system. The Transfer Function model of a two area systems with PID Controller is shown in fig.4. MATLAB version 8.0 has been used to obtain dynamic responses for a step load perturbation of 1%.

Fuzzy- Tuned Controller

Now a day's fuzzy logic is needed in all section of industry and services and also used in Automatic generation Control. The Fuzzy-Tuned Controller of the system is designed Fuzzy dissection logic controller. The fuzzy logic is based on logical system and this logical system is called Fuzzy logic

which is based on human thinking and natural language than classical logical system [16]. The fuzzy-Tuned Controller is based on Artificial Intelligent and this controller is designing for non-linear system. Fuzzy system means the human knowledge is converted in mathematical formula [17]. The Fuzzy-Tuned Controller is mainly consisted of four components; (i) Fuzzification, (ii) The Interface engine, (iii) The rule base, (iv) The Defuzzification.

In Fuzzification the Fuzzifier converts numeric value/crisp value into Fuzzy sets. The core factor of the fuzzy-tuned controller is the interface engine, which makes all logic operations in a fuzzy-tuned controller. The rule base contains of membership function and control rules. Finally, the result come out through interface process is an output of the fuzzy-tuned controller should be a numeric/crisp value. The result of interface process in fuzzy set and this result are converted into a numeric value by using defuzzifier. This operation is called Defuzzification. The response of the proportional gain and Integral gain shown in fig.2. and fig.3.

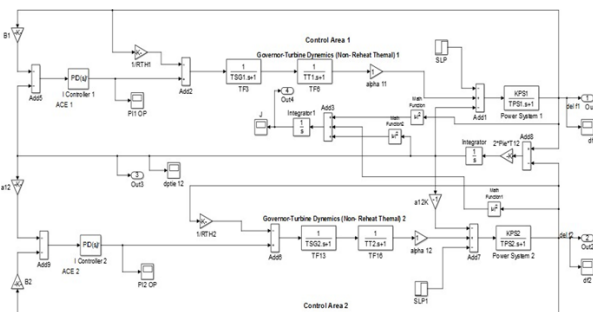
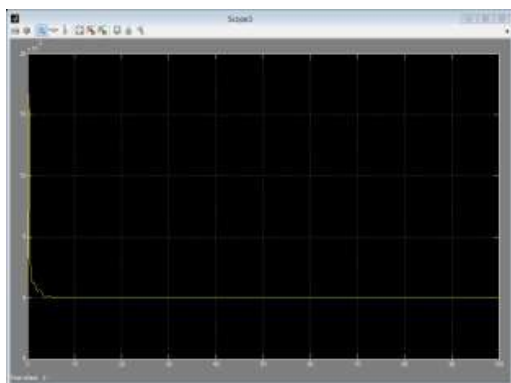
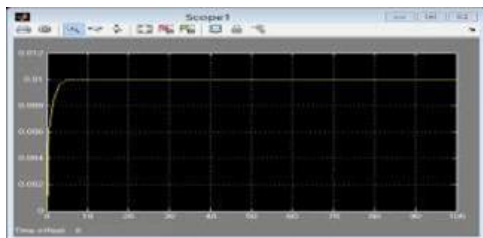


Fig.4. Transfer Function of PID controller.

PSO Optimization Technique

The PSO is optimization tools and it's providing a population based search technique and this every one called particles and this particles change their position with time. In a PSO system; particles fly around in a multidimensional

search/solution space. When each particles during the fly adjust their position on the basis of their own experience and the experience of their neighboring particle is defined by the set of particle neighboring the particles & their past experience. The particles fly for searching space with a velocity which is dynamically adjust according to own flying experience.

Let, a- A particle's co-ordinate position.

d -Their speed (velocity) in a search space.

Each particle is treated as a volume less particle and represented as a volume less particle and represented as in the x- dimensional space. The previous position of ith particle is represented as

$$a_{best} = (a_{best1}, a_{best2}, \dots, a_{bestx})$$

The index of the best particles among all the particles is treated as global best particle and represented as h_{bestx} . The velocity of i th particle is represented as,

$$d_i = d_{i1}, d_{i2}, \dots, d_{ix}$$

$$(d)_{ix}^{(t+1)} = a_{ix}^t * y + c_1 * rand() * (a_{bestix}^t - a_{ix}^t) + c_2 * Rand() * (h_{bestix}^t - a_{ix}^t)$$

$$a_{ix}^{(t+1)} = a_{ix}^t + d_{ix}^{(t+1)} \tag{2}$$

a = position of particles.
 d = velocity of particles.
 x = dimension of particles.
 h = global best
 $a_{ix}^{(t+1)} = a_{ix}^t + d_{ix}^{(t+1)}$

The modified velocity & position of each particles can be calculated using the recent value of velocity and the distance from position best to global best and this condition shown in following position; In the above equation, C_1 & C_2 are accredited as the acceleration coefficient that pull each particles towards the position best and global best. The value of $Rand()$ & $rand()$ both are the random numbers are accurate between 0 & 1.

$rand() * (a_{bestix}^t - a_{ix}^t)$ = Cognitive component
 $Rand() * (h_{bestix}^t - a_{ix}^t)$ = Social component
 w = Inertia weight factor

The low value of C_1 & C_2 recognize particles to roam far from the target regions and before being tugged back and the high values result in sudden movement towards C_1 & C_2 are usual set to be $C_1 = 1.8$ & $C_2 = 1.7$ in this project. The value of inertia weight factor $w = 1$ and the damping ratio of inertia weight $w_{damp} = 0.99$. The value of w and w_{damp} are used in I, PI, PD and PID Controller for Fuzzy-Tuned Controller this values are 1.5 & 2.0.

Simulation Results and Discussion

In this work, different control strategies for secondary control are implemented through MATLAB Simulink model. Integral Controller (I), Proportional (P) Controller, Proportional-Integral (PI) Controller, Proportional-Integral-Derivative (PID) Controller and Fuzzy-Tuned Controller are used and their results are compared.

Case-I

Firstly, we apply Integral-Controller gains in PID controller in Simulink model of two unequal area interconnected model and result waveform is shown in Fig 5(a), Fig 5(b), Fig 5(c) and also analysis; the response of settling time and overshoot time of LFC of area1 & area2 and as well as studies about tie-line power and compare their response to each other. Frequency deviation in area-1. In case of Integral controller the value of overshoot time of area1 = 8.4 and the value of overshoot time of area-2 = 3.352, Best Cost = 0.00052836.

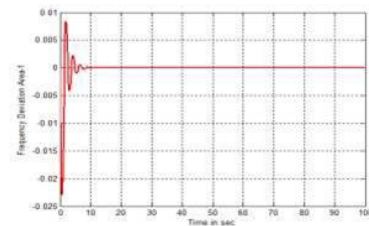


Fig 5(a). Frequency deviation in area-1 of thermal power system with integral controller




Fig 5(b). Frequency deviation in area-2 of thermal power system with integral controller.

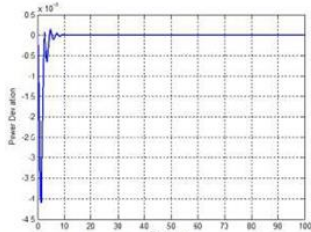


Fig 5(c). Tie line power deviation in two area thermal power system with I controller.

Case-II

Secondly, we apply Proportional-Controller gain in PID controller in Simulink model of two unequal area interconnected model and result waveform is shown in Fig 6(a), Fig 6(b) and Fig 6(c) and also analysis; the response of settling time and overshoot time of LFC of area1 & area2 and as well as studies about tie line power and their response compared. In case of proportional controller the value of overshoot time (df1) = 5.412.

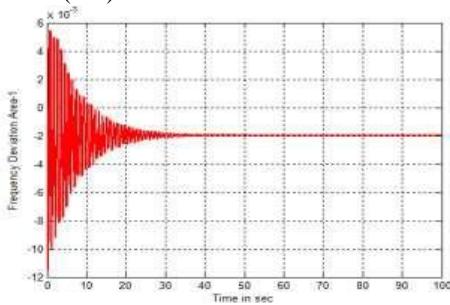


Fig 6(a). Frequency deviation in area-1 of thermal power system with P controller




Fig 6(b). Frequency deviation in area-2 of thermal power system with P controller.




Fig 6(c). Tie-line power deviation in two area thermal power system with P controller

Area1	B1	K_{f1}	K_{p1}	R1	F1 settling time	P tie-line settling time
Fuzzy-PID	0.4312	1.5000	1.5000	2.40	11.5	17
I	0.4312	0.8210	0.0000	2.40	15	13
P	0.4312	0.0000	4.6057	2.40	60	55
PI	0.4312	1.0362	2.6680	2.40	19	30
PID	0.4312	5.0000	5.0000	2.40	15.5	16

TABLE-1

Area2	B2	K_{f2}	K_{p2}	R2	F2 settling time	P tie-line settling time
Fuzzy-PID	0.500	1.4923	1.50	2.80	9.5	18
I	0.500	-0.0020	0.00	2.80	14	13
P	0.500	0.0000	5.00	2.80	66	55
PI	0.500	0.2941	5.00	2.80	30	30
PID	0.500	-0.0363	5.00	2.80	15	16

TABLE-2

Then, we apply Proportional-Integral-Controller gains in Simulink model. The gains of PI controller is optimized, and overshoot time of area-1 = 5.65, overshoot time of area-2 = 1.78 and Tie-line power deviation response is obtained, shown in fig 7(a), 7(b) and 7(c) and Table-1 & Table-2 is represent the response of this controller. The overshoot time of frequency deviation in area-1 = 5.65, overshoot time of frequency deviation in area-2 = 1.78 and overshoot time of tie-line frequency deviation = 0, Best Cost = 0.00013922.

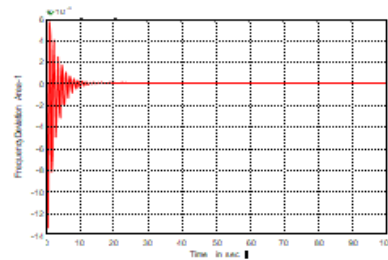


Fig 7(a). Frequency deviation in area-1 of thermal power system with PI controller.

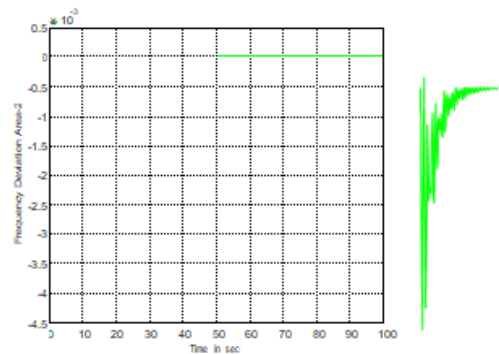


Fig 7(b). Frequency deviation in area-2 of thermal power system with PI controller.

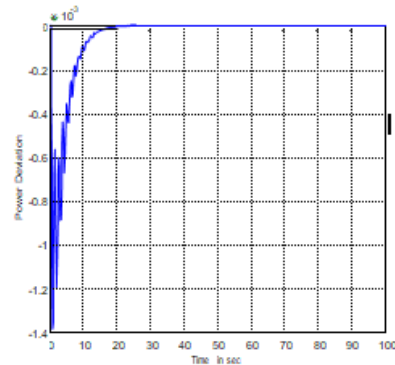


Fig 7(c). Tie-line power deviation in two area thermal power system with PI controller.

Case IV

After PID controller, we apply Proportional-Integral-Derivative - controller in Simulink model. The gains of PID controller is optimized, frequency deviation in area-1, frequency deviation in area-2 and Tie-line power deviation response is obtained, shown in fig 8(a), 8(b), 8(c) and Table-1 & Table-2 the response of this controller. The overshoot time of frequency deviation in area-1 = 3.410, overshoot time of frequency deviation in area-2 = 7.62 & overshoot time of tie-line frequency deviation = 3.85, Best Cost = 6.5136e-06.

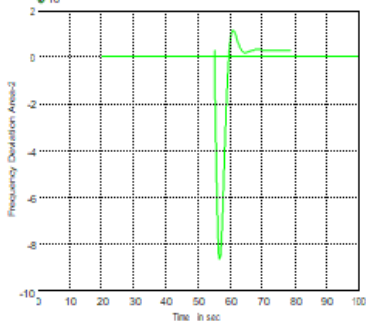


Fig 8(b).frequency deviation in area-2 thermal power system with PID controller.

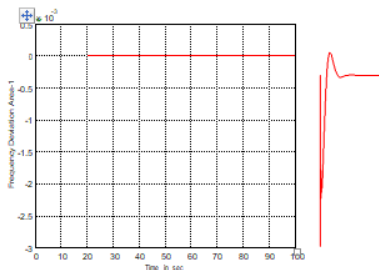


Fig 8(a).frequency deviation in area-1 thermal power system with PID controller.

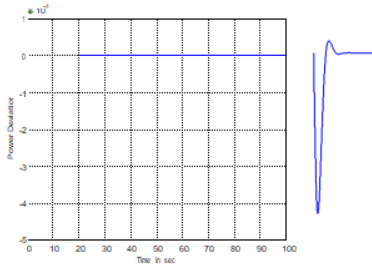


Fig 8(c).Tie-line frequency deviation into area thermal power system with PID Controller.

Case V

In the last we apply, In Fuzzy-PID-Controller we use maximum no of iteration = 50, lower & upper bound of variables = 0 to 1.5. Fuzzy-PID Controller and this controller is optimized and the response shown in Fig 9(a), Fig 9(b) & Fig 9(c) and Table-1 & Table-2. After optimization Fuzzy-Tuned Controller (Fuzzy-PID Controller) the result $\alpha_1 = 1.500$, $\alpha_2 = 1.500$ & $\beta_1 = 1.4926$, $\beta_2 = 1.500$.

The overshoot time of frequency deviation in area-1 = 1.53 , overshoot time of frequency deviation in area-2 = 0 and overshoot time of tie-line frequency deviation = 2.82, Best Cost = 0.00018912.

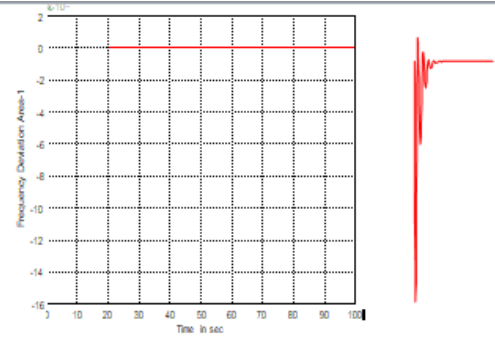


Fig 9(a).frequency deviation in area-1 thermal power system with Fuzzy- PID controller.

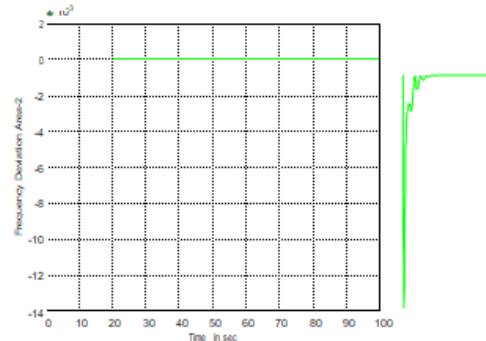


Fig 9(b).frequency deviation in area-2 thermal power system with Fuzzy- PID controller.

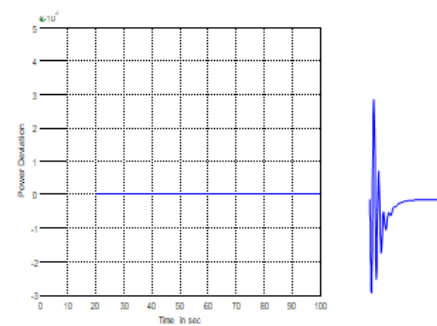


Fig 9(c). Tie-line frequency deviation in two area thermal power system with Fuzzy- PID Controller.

Appendix

KPS1 = 68.9655; KPS2 = 50; TPS1=11.49; TPS2=10; TSG1=0.06; TSG2=0.07; TT1=0.3; TT2=0.2; T12=0.0433; RTH1=2.4; RTH2=2.8; B1=0.4312; B2=0.5; a12=-1.

CONCLUSION

1. Particle Swarm Optimization Technique for simultaneous optimization of controller gains has been applied for the two unequal area interconnected in automatic generation control.
2. The optimum value of controller gains for conventional controller & soft controller and their values are:
 - (i) Best Cost (I Controller) = 0.00052836,
 - (ii) Best Cost (P Controller) = 0.0010586,
 - (iii) Best Cost (PI Controller) = 0.00013922,
 - (iv) Best Cost (PID Controller) = 6.5138
 - (v) Best Cost (Fuzzy-PID Controller) = 0.0001889.

According to this cost function PID Controller provides optimum cost better than other controller.

3. Settling time of frequency deviation in area-1 for different controller shown in Table-1. According to this Table-1 Fuzzy-PID Controller (Df1=11.5) provides better settling time to other controller.
4. Settling time of frequency deviation in area-2 for different controller shown in Table-1. According to this Table- 2 Fuzzy-PID Controller (Df2=9.5) provides better settling time to other controller.
5. Settling time of Tie-line frequency deviation in this power system for different controller shown in Table-1 & Table-2. According to this Table-1 & Table-2 Integral Controller (Df12=13) provides better settling time to other controller

REFERENCE

- [1] Allen J. Wood, Bruce F. Wollenberg, "Power Generation, Operation and Control". Second Edition.
- [2] J. Nanda, Lalit Chandra Saikia, "comparison of performances of several types of classical controller in an automatic generation control for an interconnected multi-area thermal power system. AUPEC'08,pp-022,2008.
- [3] MrinmayiBhowmik, DebashishBasak "A critical comparative observations on AGC of Thermal Power-CSP system using Frie-fly Algorithm based classical control".vol.6 Issue 4 march 2016.
- [4] C. Concordia and L. K. Kirchmayer, "Tie-line power frequency control of electric power system: Part II," AISE Trans, III-A, vol. 73, pp. 133–146, Apr. 1954.
- [5] Bevrani H. Robust power system frequency control. New york. Springer 2009.
- [6] Ibraheem, Kumar P. Kothari DP. Recent philosophies of AGC strategies in power system.IEEE Trans Power system 2005; 20(1):364-57.
- [7] O. I. Elgerd and C. E. Fosha, "Optimum megawatt-frequency control of multiarea electric energy systems," IEEE Trans. Power Appar. Syst., vol. PAS-89, no. 4, pp. 556–563, Apr. 1970.
- [8] C. E. Fosha and O. I. Elgerd, "The megawatt-frequency control problem-A new approach via optimal control theory", IEEE Trans. Power Appar. Syst., vol. PAS-89, no. 4, pp. 563-577, Apr. 1970.
- [9] Yazdizahde A. Rmezani MH, Hamedrahamat P. decentralized load frequency control using a new robust optimal MISO PID controller. Int J Electr Power energy System 2012; 35:57-65.
- [10] K. Vasu, G. Bhanuchandar and V. Ganesh, Member, IAENG AGC of multi areathermal system by using FOC. WCECS 2016, October 19-21, 2016, San Francisco, USA. Voll.
- [11] KapilGarg*, JaspreetKaur**, "Particle Swarm Optimization Based Automatic Generation Control of Two Area Interconnected Power".Volume 4, Issue 1, January 2014 ISSN 2250-3153.
- [12] Jeevithavenkatachalam, Rajalaxmi. "Automatic generation control of two area interconnected power system using particle swarm optimization". IOSR Journal of Electrical and Electronics Engineering (IOSR-JEEE) e-ISSN: 2278-1676,p-ISSN: 2320-3331, Volume 6, Issue 1 (May. - Jun. 2013), PP 28-36.
- [13] Tridipta Kumar Pati, JyotiRanjanNayak, Binod Kumar Sahu, Sanjeeb Kumar Kar, "Automatic Generation Control of Multi-Area Thermal Power System using TLBO Algorithm Optimized Fuzzy-PID Controller", 2015 International Conference.
- [14] KapilGarg*, JaspreetKaur, "Particle Swarm Optimization Based Automatic Generation Control of Two Area Interconnected Power System", International Journal of Scientific and Research Publications, Volume 4, Issue 1, January 2014 1 ISSN 2250-3153.
- [15] O.I.Elgerd, "Electrical Energy systems Theory An Introduction" Second edition; 1983, Tata McGraw-Hill;Newdelhi.
- [16] Aswini Kumar Patel, MrDharmendra Ku. Singh, MrBinod Kumar Sahoo, "Automatic generation control of a two unequal area thermal power system with PID controller using Differential Evolution Algorithm". Vol. 3, Issue 4, Jul-Aug 2013, pp.2628-2645.
- [17] Emad Ali Daood, A.K. Bhardwaj, "Interconnected system for Grid stability with PI and Fuzzy-PID controller.Vol. 5, Issue 5, may 2016.